


SVOC DETECTIONS IN DRINKING WATER FROM THE JAMES PARK VICINITY

This map shows semi-volatile organic compounds (SVOCs) associated with coal tar that were detected near James Park

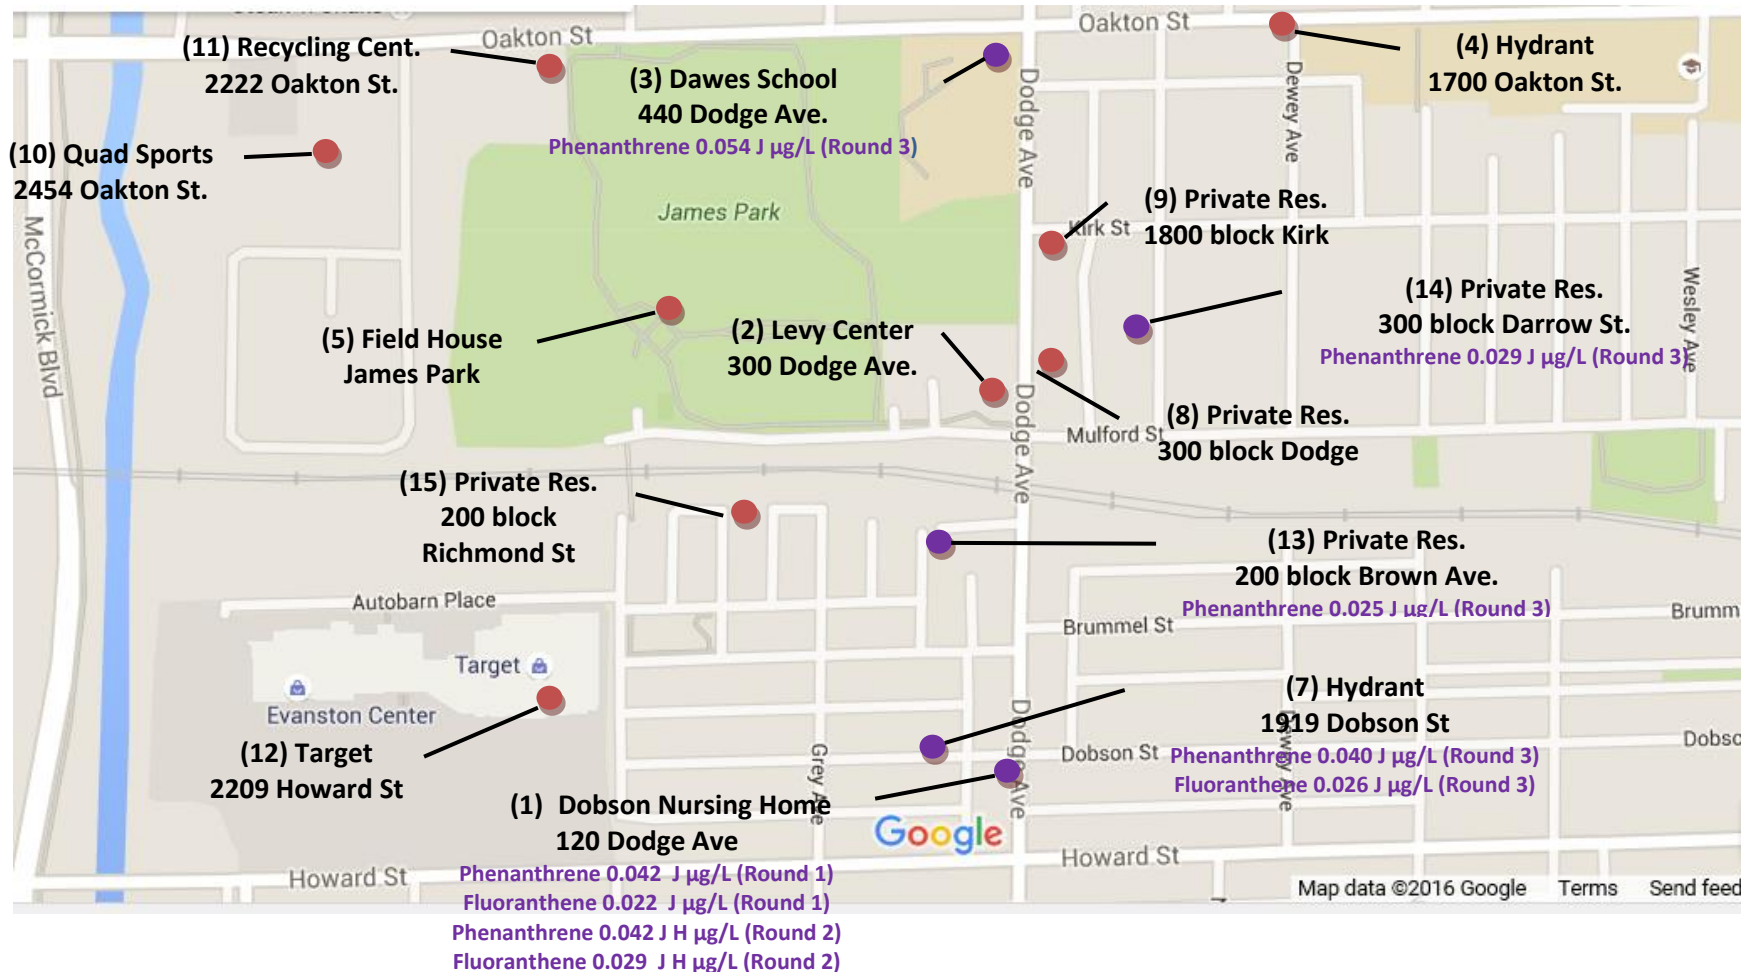

Notes:

- 1) All of the concentrations are reported in micrograms per liter (µg/L), parts per billion (ppb)
- 2) There are Illinois EPA (IEPA) Class I Potable Water Standards 35 IAC 620.441 for Fluoranthene (280 ppb) and Phenanthrene (210 ppb) that are used to compare results of the water testing results. The water testing results shown are significantly (99.9%) below the referenced standards.